
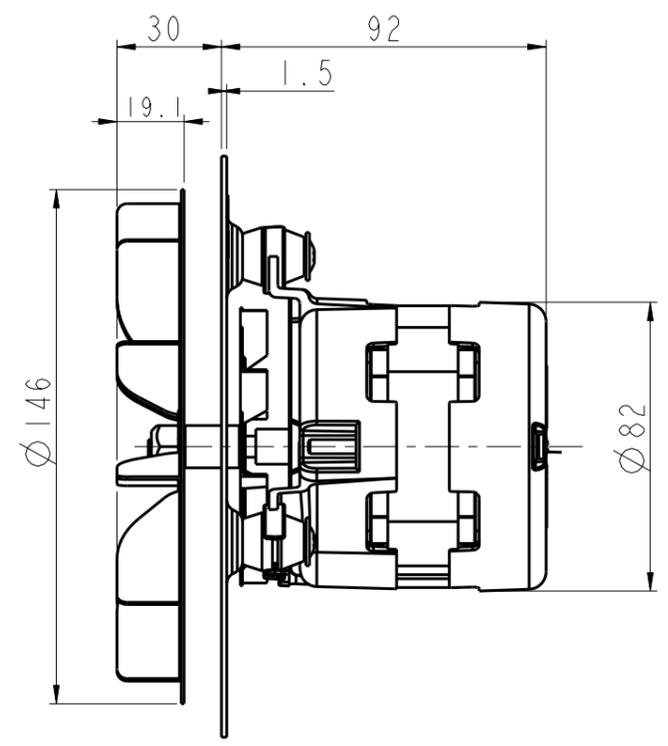



LUNGHEZZE CAVI (mm) ±20	
A-B	1380
A-G	1850
A-F	1300
F-E	500
C-I	720
A-D	1800
A-H	400

PARTICOLARE ETICHETTA

**SIT S.p.a.**   
 PL20CE0120  
 Code W931200120  
 AC 220-240 50-60Hz 35W CLF RO ZP  
 n° XXXXXXXX dd/mm/yy

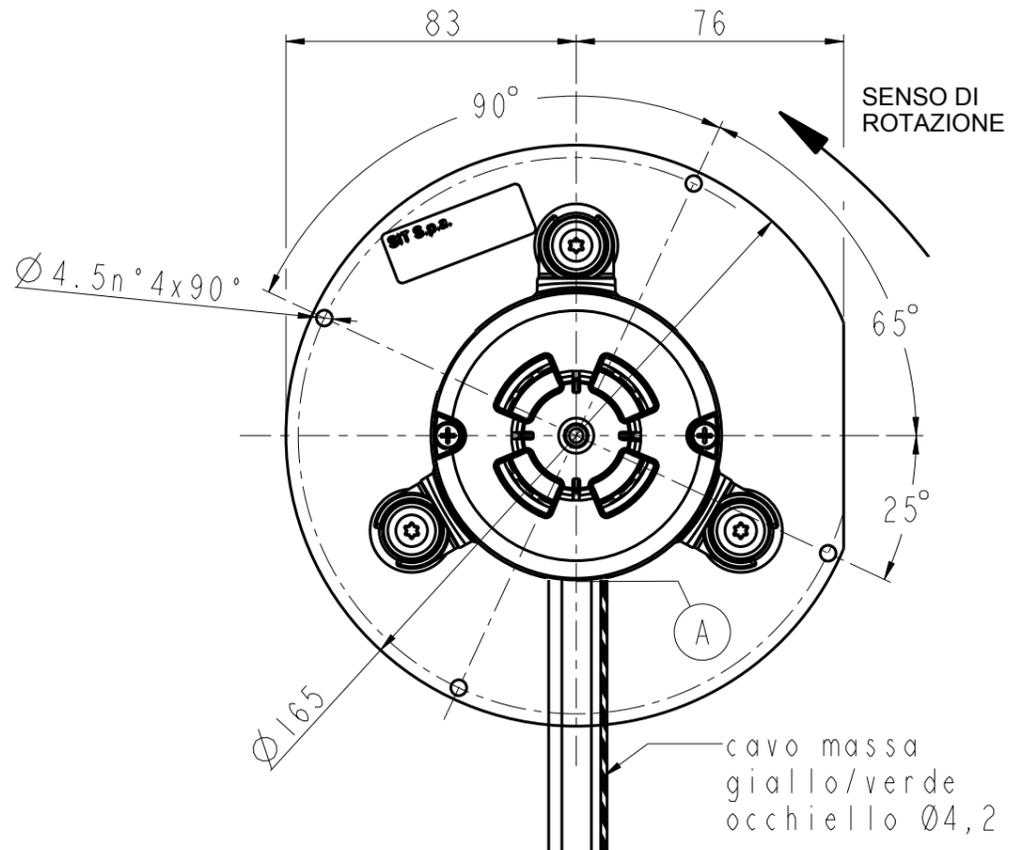


SCHEMA DI COLLEGAMENTO MOTORE / SENSORE DI HALL

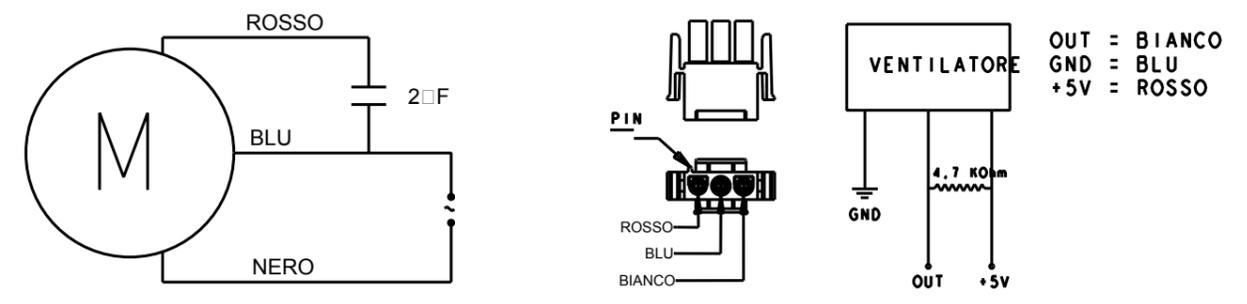

- TERMINALI CABLAGGI : □
- CAVO TERRA OCCHIELLO Ø4,2 INTERNO □
  - CAVO SENSORE DI HALL CONNETTORE MASCHIO MATE-N-LOCK 3 VIE PUNTALINI MASCHIO □
  - CAVO ALIMENTAZIONE FASTON FEMMINA 6,3x0,8 CON COPRIFASTON □
  - CONDENSATORE 2µF+CODOLO M8 COLLEGATO


DIMENSIONS BETWEEN [...] ARE IN INCHES  
ALL DIMENSIONS ARE INDICATIVE

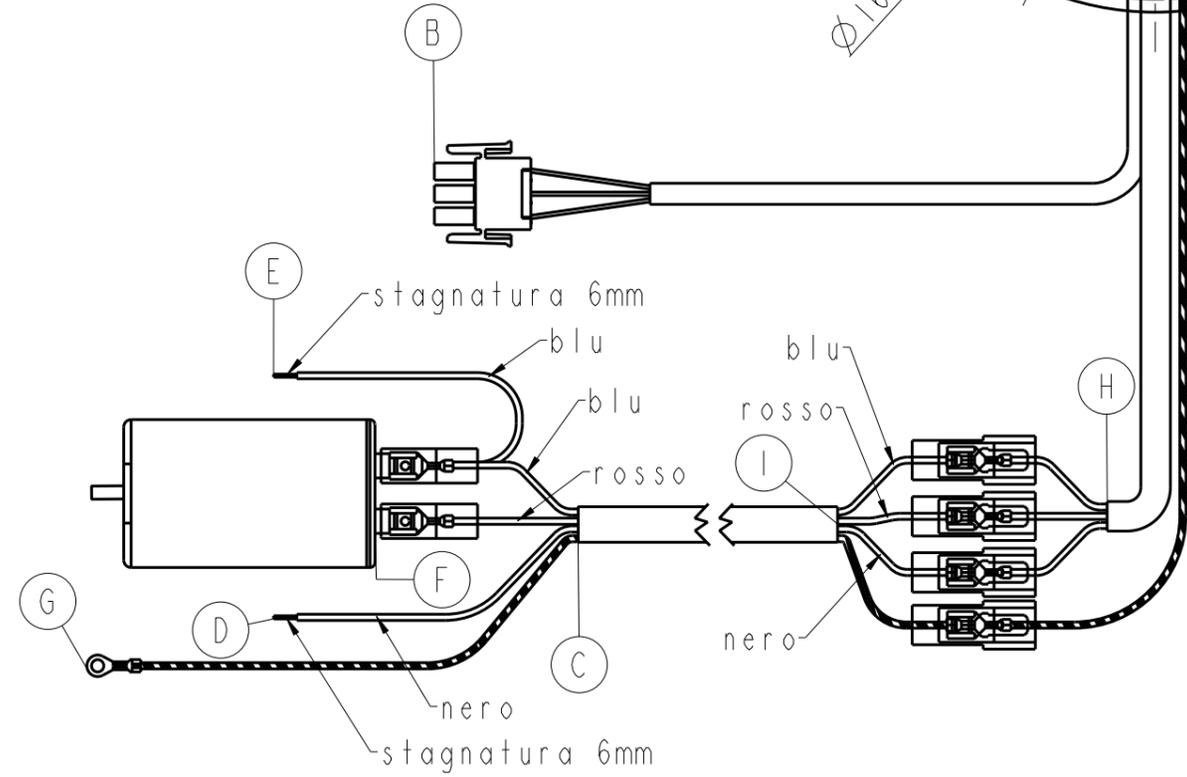

DRW FILE NAME  
D931200120A

Rev.	IM.-N°	Date	Description	Name

Drawn	17/06/2020	Description	GRUPPO PL20CE 220-240V 60Hz	Customer	
Date		Technical Information		Ra	General Roughness
		Material		Scale	ISO
		Material Condition		1:2	
		Heat Treatment		Replaces Dwg N°	
		Surface Treatment		Customer Drawing	Sheet 1/1
		Sealing Surface	-----	Surface Hardness	
				Code	W931200120
				Frm.	A3

 This drawing may not be copied or disclosed to third person without permission of SIT. We are the owner of this drawing.  
**SIT** S.p.A.  
 35129 Padova (Italy) Viale dell'Industria 31/33