

| Ref. No. | LGETH -170127-007 |
|-----------|-------------------|
| Date | Jan. 27. 2017 |
| Rev. No. | Rev.1 |
| Rev. Date | May.28.2021 |

LG Electronics Inc.

SPECIFICATION SHEET for APPROVAL

MODEL : GVS265PAB (Tropical)

CUSTOMER : EMBRITAL

| | APPROVAL |
|--------------------------|----------|
| Name | |
| Date | |
| AIR CONDITIONER MODEL | |

LG Electronics Inc.

| | Designed | Checked | Approved |
|------|-------------|--------------------|-----------|
| Name | 10 | Engl | Chalpapan |
| Date | 31 May 2021 | 31. May. 21 | 31 May 21 |
| | 5 | ORIGINAL 310521 | |

Please Return 1 Copy on Your Approval.

Air Conditioning Compressor Division LG Electronics Inc. Tel : (+66)38 - 923 - 109 Fax : (+66)38 - 923 - 119

| | Ref. No. | LGETH -170127-007 |
|--------------------|-----------|-------------------|
| | Date | Jan. 27. 2017 |
| | Rev. No. | Rev.1 |
| 0.Revision History | Rev. Date | May.28.2021 |
| | | |

| Date | Rev. No | Rev. description | Write |
|------------|------------|---|-------------|
| | | Page 7/13 -Change sleeve damper from P/N.4816U-L001G→ 4816U-L001H | |
| 28.05.2021 | | Page 13/13 Revise label format (Refer 4M Change confirm) | Thunyarat D |
| | | Page A-8 -Change sleeve damper from P/N.4816U-L001G→ 4816U-L001H | |
| | | -Revise spec sleeve damper length from 34→37 mm (Actual spec) | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |

| | | | Ref. No. | LGETH -170127-007 |
|-----|------------------------------|--|-----------------------|-------------------|
| | | | Date | Jan. 27. 2017 |
| Sne | ecification | | Rev. No. Rev. Date | Rev.0 |
| - | ompressor | | Nev. Date | <u> </u> |
| | | | | |
| 1 | Model Name | G | VS265PAB | |
| 2 | Compressor Type | Hermetic | Motor Com | pressor |
| 3 | Compression Type | Rotary Type | e (Rolling Pi | ston Type) |
| 4 | Application | Refrigeration system (Cooling & Heating) | | |
| 5 | Refrigerant | R410A | | |
| 6 | Safety Approval | | - | |
| 7 | Oil / Oil Charging Amount | PVE(FVC | 68D) / 540 | 0 ± 10cc |
| 8 | Displacement | 20 | 6.5 cc. / rev | |
| 9 | Painting | Blac | ck Color Pai | int |
| 10 | Net Weight (Including Oil) | 19.9 kg | | |
| 11 | Suction Tube I.D | Q | ð 16.0 mm | |
| 12 | Discharge Tube I.D | Ç | ð 9.7 mm | |
| | | I | | |

1.2 Motor

| Motor Type / Starting Type | Single Phase Induction Motor / PSC | | |
|----------------------------|------------------------------------|---------------|--|
| Pole / Rated Output | 2 Pole / 1,980 Watts | | |
| Power Source | 1 Ph - 220~240 Volts - 50 Hz | | |
| Rated Revolution | 2,842rpm | | |
| Insulation Class | E Class | | |
| Windings Resistance | Main | 1.43 ± 7% [Ω] | |
| (at 25 °C) | Sub | 2.22 ± 7% [Ω] | |
| Locked Rotor Ampere | 54 A (at 240 V) | | |

TH-COMP-ED-095-A4 (13.05.06)

| | | Ref. No. | LGETH -170127-00 |
|---|--------------------|--|--|
| | | Date | Jan. 27. 2017 |
| | | Rev. No. Rev. Date | Rev.0 |
| 3 Wiring diagram | | | P |
| Run | ining Capacitor | Compressor | |
| ※ Make Sure to connec | t right way same | with the wiring di | agram. |
| 4 Electrical Component | | | |
| | | | |
| Running Capacitor | | 50 MFD / 400 | VAC |
| Running Capacitor Overload Protector | INTI | 50 MFD / 400 ERNAL TYPE (UF | |
| Overload Protector 5 Performance | INTI | ERNAL TYPE (UF | 914SE5245) |
| Overload Protector 5 Performance Voltage | | ERNAL TYPE(UF 220 V | 240V |
| Overload Protector 5 Performance | [BTU/h] | ERNAL TYPE (UF 220 V 22,850 | 240V 22,950 |
| Overload Protector 5 Performance Voltage | | ERNAL TYPE(UF 220 V | 240V |
| Overload Protector 5 Performance Voltage | [BTU/h] | ERNAL TYPE (UF 220 V 22,850 | 240V 22,950 |
| Overload Protector 5 Performance Voltage Cooling Capacity (-5%↑) Power Input (+5%↓) EER (-5%↑) | [BTU/h] [W] | ERNAL TYPE (UF 220 V 22,850 6,696 | 240V 22,950 6,725 |
| Overload Protector 5 Performance Voltage Cooling Capacity (-5%↑) Power Input (+5%↓) | [BTU/h] [W] | ERNAL TYPE (UF 220 V 22,850 6,696 2,210 | 240V 22,950 6,725 2,275 |
| Overload Protector 5 Performance Voltage Cooling Capacity (-5%↑) Power Input (+5%↓) EER (-5%↑) [BTU/w・hr] | [BTU/h] [W] | ERNAL TYPE (UF 220 V 22,850 6,696 2,210 10.34 | 240V 22,950 6,725 2,275 10.1 |

| | | Ref. No. Date | LGETH -170127 Jan. 27. 2017 |
|---|---|------------------|---------------------------------|
| | | Rev. No. | Jan. 27. 2017 Rev.0 |
| | | Rev. Date | - |
| loise & Vibration | | | |
| Voltage | 9 | | At 240 V |
| Sound Level | [dB(A)] | | 74 Max |
| Vibration | [µm] | | 230 Max |
| Noise & | Vibration Measuring Pc | | 300mm |
| 300mm | Aicrophone | | - A - T - B Microphone |
| Measuring points for specified of the second second | (, Y_) | | |
| Compressor vibration is r contacted compressor | measured by a vibration \bigcirc ~ \bigcirc | meter whicl | h is |
| Test Condition : Standard Condition (Ps) | s/Pd = 9.12 / 33.45 kg/c | :m²G) | |
| | | | |
| | | | |


| | | | | Ref. No. | LGETH -170127-007 |
|--|---------------|-------------|-------------|--|------------------------|
| | | | | Date Rev. No. | Jan. 27. 2017 Rev.0 |
| 1.7 Minimum Startir | a Voltac | 10 | | Rev. No. | - |
| | iy voltag | Je | | | |
| Cold Start | | | | | |
| - Temp. Condition : 35° | С | | | 187 Volts N | /lax. |
| - Balanced pressure : $Pd - Ps \le 0.5 \text{ kgf/cm}^2$ | | | | | |
| - Balanced pressure : Pd – Ps = 0 kgf/m² | | | 176 Volts N | Лах. | |
| 1.8 Voltage Range | | | | | |
| at Standard | Condition | | | 187 ~ 264 | Volts |
| at Overload | Condition | 1 | | 198 ~ 264 | Volts |
| Test Conditions | | | | | |
| | | Stan | dard | Overload | |
| Con. Temp (°C) | | 54.4 | | 64.4 | |
| Eva. Temp (°C) | | 7.2 | | 15.7 | |
| Return Gas. Temp (°C | 2) | 35 | .0 | 25.0 | |
| Ambient Temp (°C) | | 35 | .0 | 54.0 | |
| 1.9 Others | | | | | |
| Leak Tight Pressure | High | Pressure S | ide | 42 kg | f/cm²G |
| Loak nghi rocoaro | Low F | Pressure S | ide | | - |
| Hydrostatic trength | High | Pressure S | ide | 170 kg | gf/cm²G |
| Pressure | Low F | Pressure Si | ide | 69 kgf / ㎝ G | |
| Insulation Re (with 500V [| | Tester) | | 50 MΩ Min. | |
| Withsta | and Voltag | je | | At 2,200 V / 1 Sec. Leakage Current is less than 5 m/ | |
| Residual Moisture | e (Karl Fisl | her Method |) | 80 m | g Max. |
| * Resid | ual Impurit | ies | | 70 m | ng Max |
| *) Each part was meas | sured sepa | arately | | | |

| Ref. No. | LGETH -170127-007 |
|-----------|-------------------|
| Date | Jan. 27. 2017 |
| Rev. No. | Rev.1 |
| Rev. Date | May.28.2021 |

2.Delivered Parts List

| | | | Parts Dwg. NO. | | |
|--------------------|--|----|----------------|-----|------|
| Parts Name | Type(Model) | EA | LG | Su | oply |
| Compressor | GVS265PAB | 1 | - | YES | NO |
| O.L.P | INTERNAL TYPE | - | - | YES | NO |
| Cover, Terminal | - | 1 | 3550U-L005D | YES | NO |
| Gasket | - | 1 | 4986UHL004A | YES | NO |
| Nut, Common | - | 1 | FAD30241201 | YES | NO |
| Washer, Customized | - | 1 | FAF30240201 | YES | NO |
| Damper, Rubber | - | 3 | MCQ61847401 | YES | NO |
| Sleeve, Damper | 1 | 3 | 4816U-L001H | YES | NO |
| Bolt, Stud | - | - | - | YES | NO |
| Washer, Plain | - | - | - | YES | NO |
| Nut, Hexagon | - | - | - | YES | NO |
| Capacitor | - | - | - | YES | NO |
| Screw, Earth | M4*0.7, Length : Max 0.236 [6 mm]. | - | - | Yes | No |

%) Refer to Attachments (Accessory Parts Drawings.)

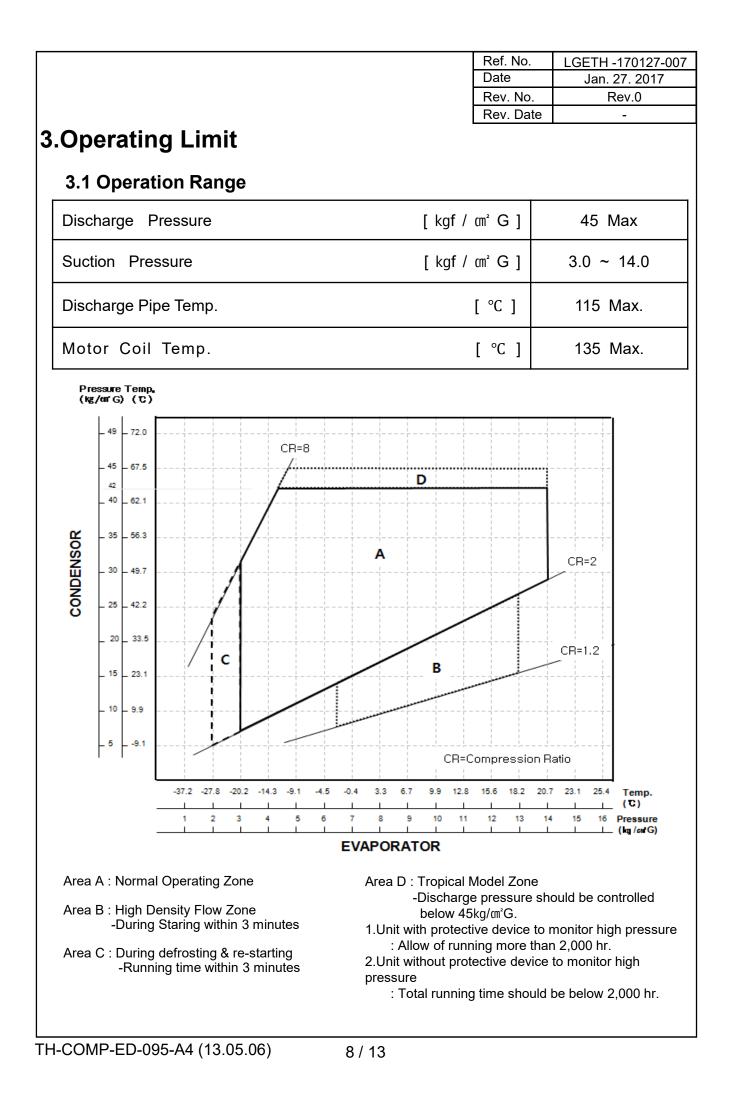

| * This guide contains many important safety | messages. Always read and obey all safety messages. | Ref. No. | LGETH -170127-007 | |
|--|---|---------------|-------------------|--|
| | | Date | Jan. 27. 2017 | |
| A WARNING You can be ki | illed or seriously injured if you don't follow instructions. | Rev. No. | Rev.0 | |
| 3.2 Application Lim | it | Rev. Date | - | |
| Refrigerant Charge Limit | [SRAC : Cooling pump] 2,030g Max (*K \approx 0.4, **OIL Dilution Rate \approx 0.20) [SRAC : Heat Pump] 1,720g Max (*K \approx 0.5, **OIL Dilution Rate \approx 0.22) | | | |
| Liquid Refrigerant Back | System should be designed not to allow the liquid to go back to compressor which cause knocking noise , current increase or undesirable vibration. | | | |
| Δ T : Temp. Difference ^o C | Δ T = Case Bottom Temp Condensing Temp. It must be kept Δ T ≥ 5°C | | | |
| Pressure Difference in Operating | The Pressure difference in operating shall be 5.0kgf/m² or more, but 3 minutes starting excluded. | | | |
| ON/OFF Operation | Each cycle should be at least 6 minutes (ON Time : at least 3 minute,OFF Time : at least 3 minutes) | | | |
| Pressure Difference at Starting | When starting, discharge pressure is balanced with suction pressure. (Pd – Ps \leq 0.5 kgf/m ²) | | | |
| Tilt in Operation | The allowable tilt of the compressor in operation shall be 5° or less. | | | |
| | The Accumulator volume should be e system refrigerant volume. | nough to cove | r 50% of maximum | |
| | Effective Volume of Accum. × Specific gravity of Refrigerant * K = | | | |
| System Accumulator | | | | |
| | ※ Effective Volume of Accumulator = 691 (m³) ※ Specific Gravity of Refrigerant (R410A) = 1.2 g/(m³) (at 20°C) | | | |
| | If coefficient "K" does not meet recommendation, refrigerant system must check liquid back phenomenon at accumulator. | | | |
| Protecting Reverse Operation | The compressor must be operated by proper voltage in accordance with the frequency without reverse revolution condition. The reverse revolution condition can be avoided by just keeping right order of phase supplied power source. | | | |

A WARNING

| Ref. No. | LGETH -170127-007 |
|-----------|-------------------|
| Date | Jan. 27. 2017 |
| Rev. No. | Rev.0 |
| Rev. Date | - |

3.2 Application Limit

| Frequency Range | Rated Frequency ±2% |
|--------------------------|---|
| Pipe Stress | Don't allow any force on discharge & suction pipe . The piping stress must be less than 300kgf/ဏ² at starting and stopping. And less than 153kgf/ဏ² at running. |
| Oil Level | It must be checked oil level by the compressor with sight glass we supply. And oil level must be kept over guide line level **note ² . at any condition. |
| Protection device | Refrigeration system must has the compressor protection device like over pressure, high temperature, sensing locked pump in the controller. When starting & running fail by abnormal overload, controller must be able to cut off power of compressor before motor burn out. |
| Pump down refrigerant | If pump down time is too long, compressor can be damaged due to excessive temperature increase or poor lubrication. Guideline of pump down process. - Time : less than 30 seconds - Suction Pressure : It should not run under below 1kgf/m²G. And before closing a service valve, compressor running for more than 5 minutes is recommended. |


※ If gas charge amount of refrigerant specified is exceeded,

both parties should discuss the matter to determine compressor specification. (accumulator volume, lubricating oil amount) and system specifications (crank case heater, oil separator, additional accumulator, etc)

| Ref. No. | LGETH -170127-007 |
|-----------|-------------------|
| Date | Jan. 27. 2017 |
| Rev. No. | Rev.0 |
| Rev. Date | - |
| | |

3.3 Process Limit

| Use defined Refrigerant and oil | Any process in where the HCFC's refrigerant or the different kind of oil against the defined. Compressor oil are mixed should be avoided. |
|---|---|
| Avoid Damage running | The running operation that inspection and the protector inspection that affect a damage to the function and durability of the compressor should be avoided |
| Running dummy indoor | When the outdoor unit is operated with the indoor dummy unit, the discharged oil should be recovered enough |
| Prevent oxidation in pipe | Always purge the system and the compressor with the dry nitrogen in order to prevent oxidation of the piping |
| Charging Refrigerant | When charging refrigerant into the cycle, make sure that refrigerant always be filled from the higher pressure side (condenser exit) of the cycle. If liquid refrigerant is sucked in to the compressor liquid compression occurs, The discharge valve is damaged, lubrication effectiveness degenerates and reliability drops noticeably |
| Avoid Vacuum running | Do not operate the compressor in a vacuum state. Furthermore do not apply high voltage to a vacuum state compressor. There is a danger that insulation could degenerate, causing electric shock |
| Avoid Air compression | Do not compress the air including the case of leakage in the refrigeration cycle. If compressors run with air mixed, inside the compressor is heated and pressurized , which may cause an explosion |
| Promptly Assemble compressor in line | After removing rubber plugs from compressor tubes, Promptly use the compressor. And do not leave in the atmosphere for 10 minutes over. If Air gets into the compressor, accelerating degeneration of the inside of the cycle or compressor |
| Wiring | Wires connected to the compressor, follow the compressor specification manual and instructions |
| Storage temperature | -10°C ~ 65°C |
| | |

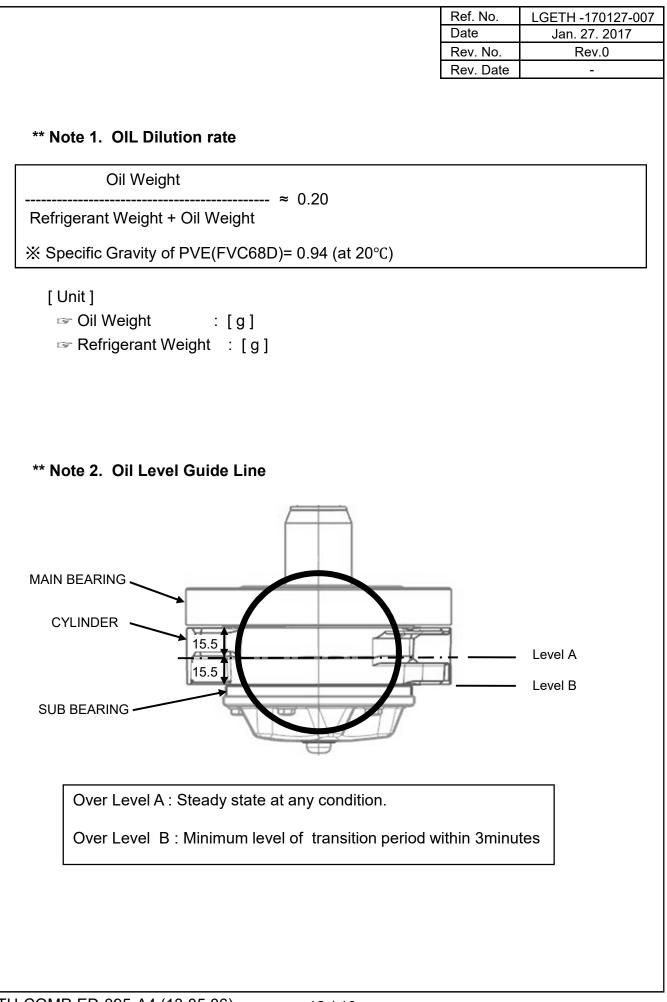

| | | Ref. No. | LGETH -170127-007 |
|-------------|---|-----------|-------------------|
| | | Date | Jan. 27. 2017 |
| | | Rev. No. | Rev.1 |
| * LABEL * | \wedge | Rev. Date | May.28.2021 |
| | 66 | | |
| [UNIT : mm] | GVS265PAB $$ C C THERMALLY PROTECTED R410A 1PH 50Hz 220-240V ~ LRA 54 SERIAL NO. | ₹ • | |
| | Bar Code | | |
| | | | |
| | | · [| |
| | Senice should be performed by trained personnel only. Entretien à réaliser par du personnel qualifié. | | |
| | ELECTRIC SHOCK HAZARD -Ground the equipment securely. -Tum off the power before servicing. -Mount the terminal cover in place. -Motivate cache-bomis en place | | |
| | BURN HAZARD RISQUE DE BRÚLURE -Do nottouch with bare handsNe touchez pes à mains nues. | E. | |
| | EXPLOSION OR FIRE -Var protective goggles. -Do not compress air. -Use specified refrigerant & oil. -Use specified refrigerant & oil. -Use specified refrigerant & oil. | J | |

All safety messages will identify the hazard, tell you how to reduce the chance of injury, and tell you what can happen if the instructions are not followed. You are strongly advised to follow these safety instructions.



This is the Safety alert symbol. It indicates a hazardous situation which, if not avoided, could result in death or serious injury.



This is the Electric shock hazard symbol. It indicates a hazardous situation which, if not avoided, could result in the electric shock.



This is the Getting burnt symbol. It indicates a hazardous situation which, if not avoided, could cause fire.



This is the Explosion or Fire symbol. . It indicates a hazardous situation which, if not avoided, could cause explosion or fire.

*1. Effective Period of This Document *


This document will be effective after LG's receipt with your authorized signature. When design modification is approved by the customer , the current document is unavailable.


*2. Compressor operating range *


The Compressor can operate within the limits of the outlined area. Outside these operating fields, the system cause early defects in the compressor. The compressor defects caused by applications operating outside the outlined area will not be considered under the warranty. If the appliance be operated out of the operating range, it must be agreed with the supplier.


Attachment


| | | PAGE |
|------------------------------|---|-----------|
| 1. Compressor Drawing | • | A- 1 |
| 2. Accessory Fitting | • | A-2 |
| 3. Part Drawings. | • | A-3 ~ A-8 |
| 4. OLP Characteristic Curve | • | A-9 |
| 5. Guideline for using R410A | • | A-10 |

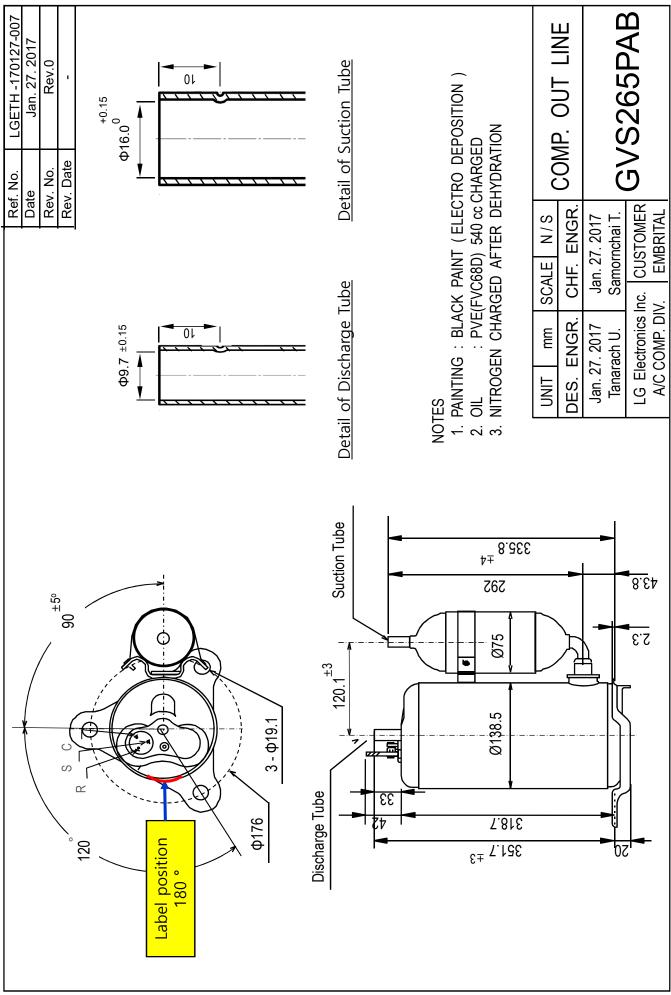


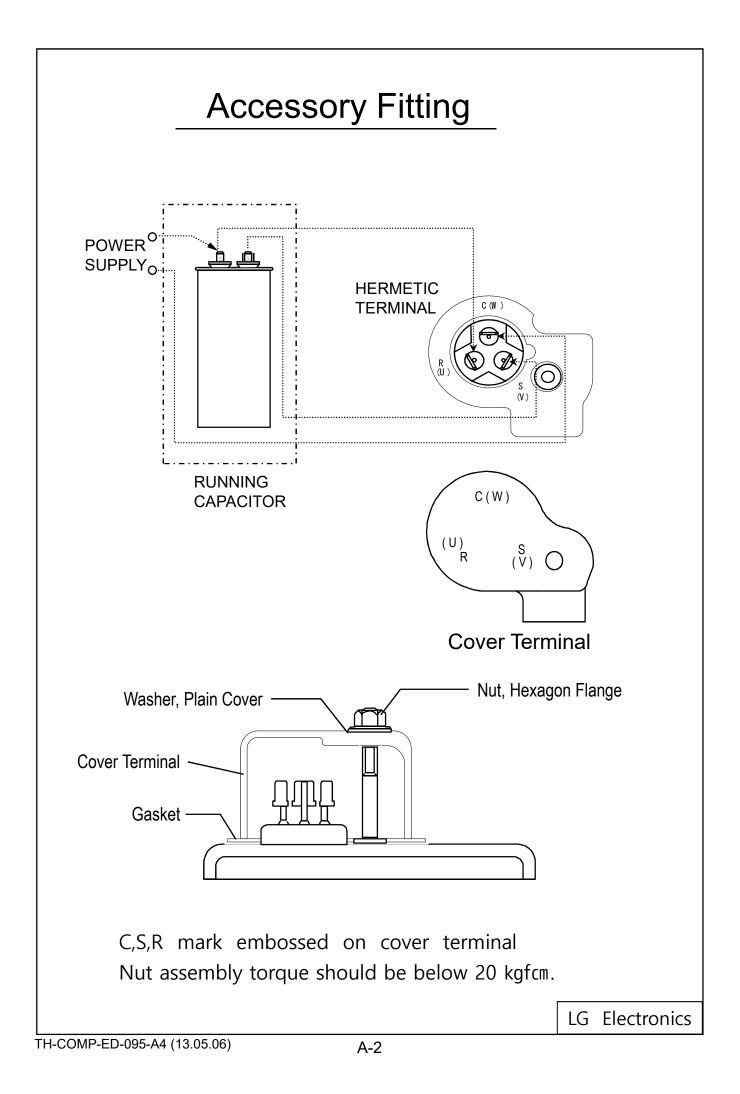


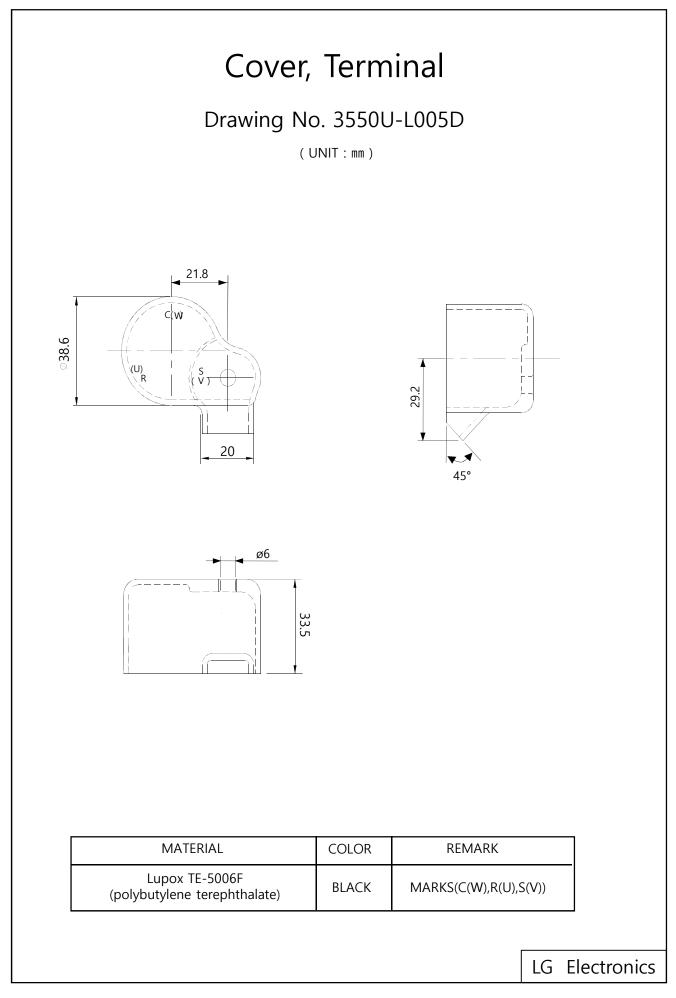


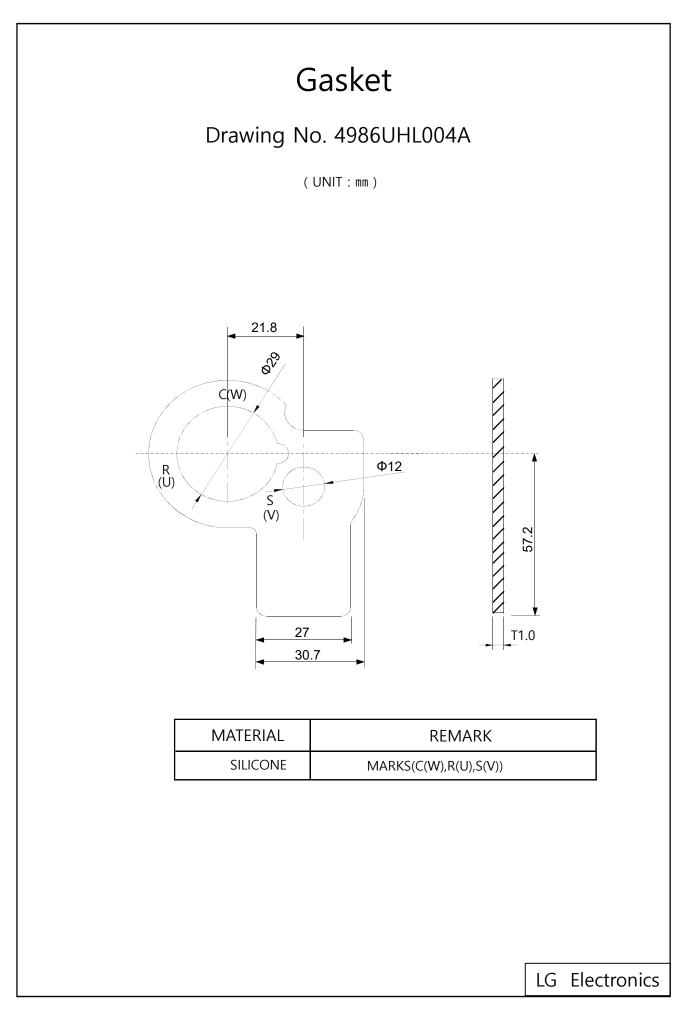


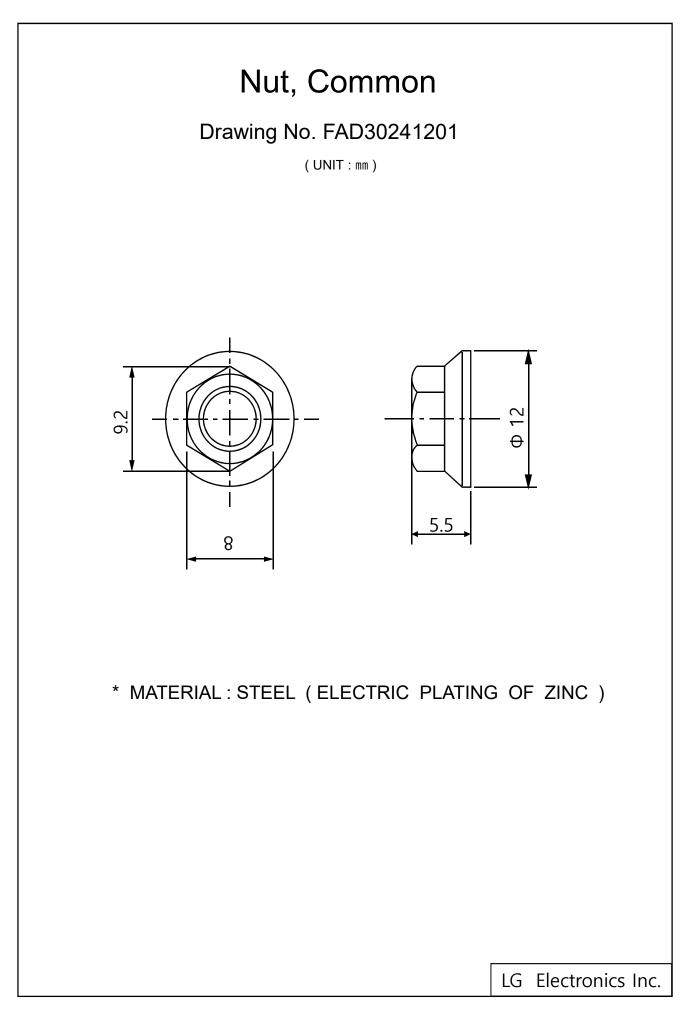

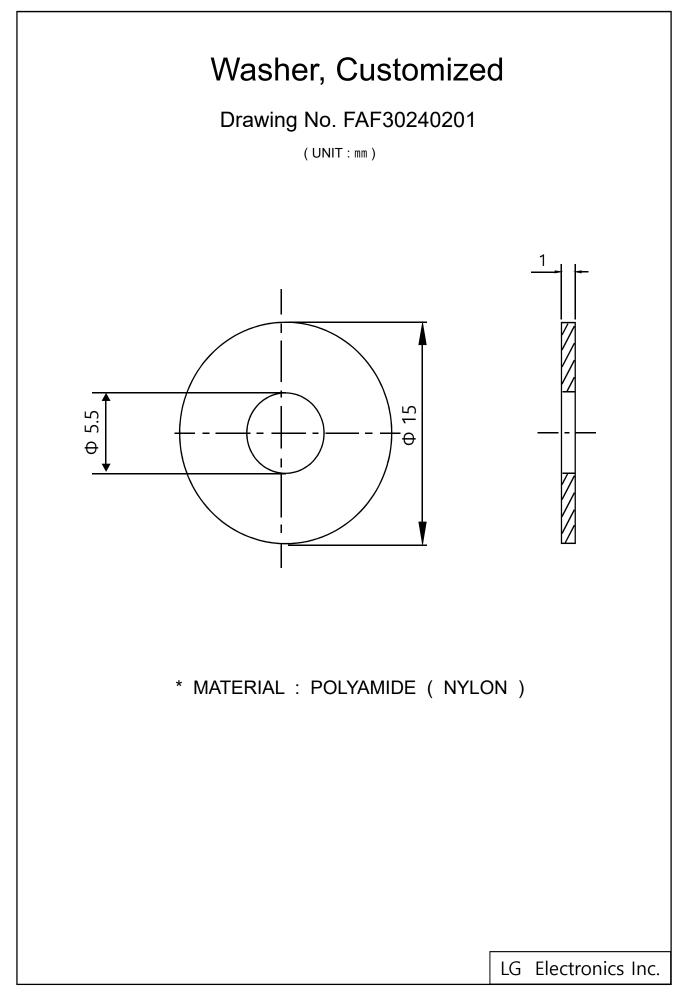

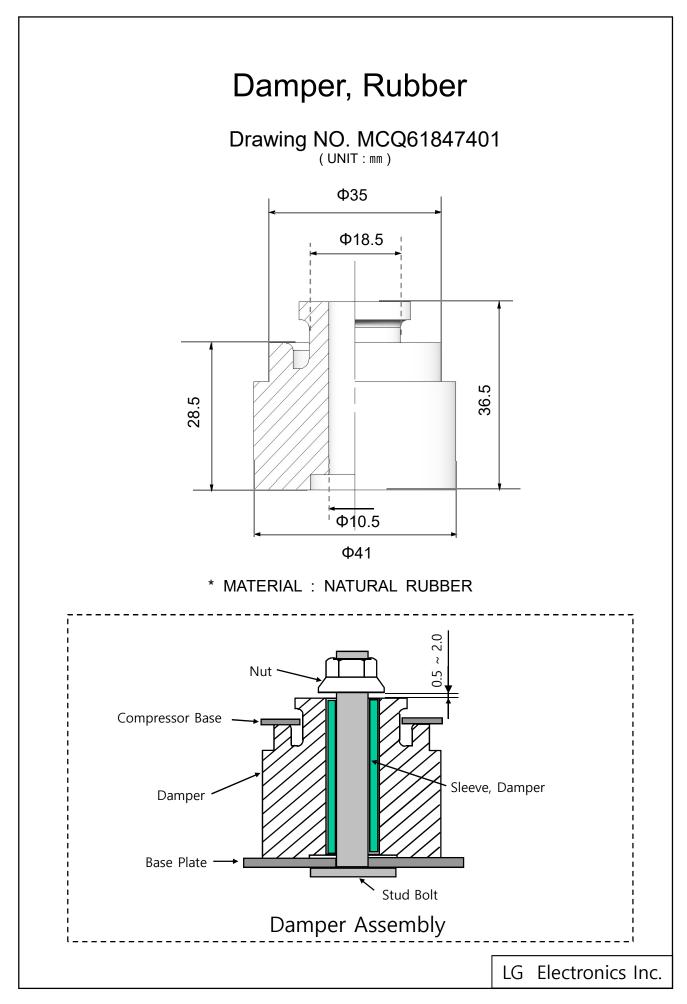

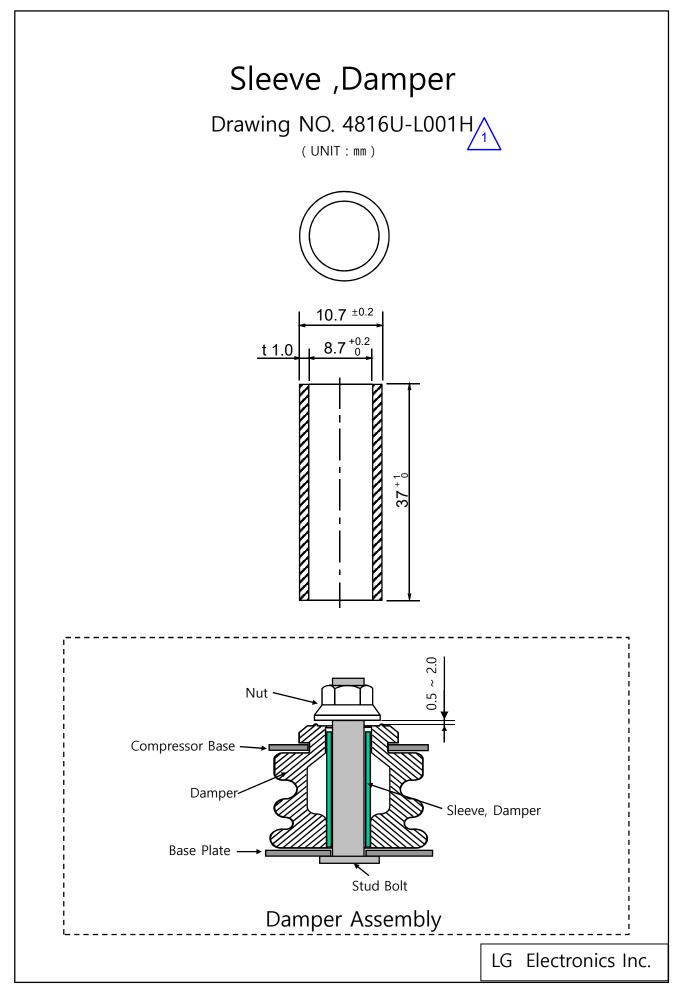

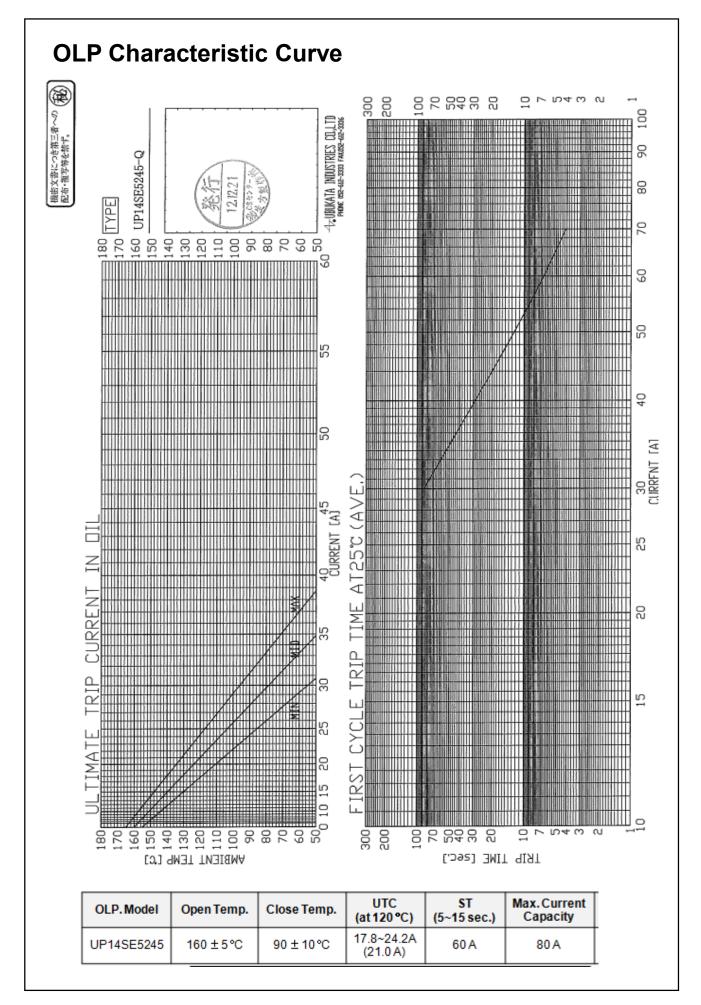

Guideline of using R410A

Process Control

1. Residual Moisture

Moisture control of lubricant is very important, because hydrolysis of lubricant causes many problems.

2. Residual Chlorine

Chloric furuoro carbon and solvent cause decomposition of oil, no chlorine is recommended (if impossible, below 100 ppm)

3. Contamination Control

Contamination accelerate wear of compressor parts and decomposition of oil. Therefore contamination control must be required.

4. Compressor Sealing

It is recommended to assemble compressor within **5 minutes** after removing sealing cap of compressor.

5. Tube Connection

When brazing welding for tube connection, no use of Flux is recommendable.

Facilities

1. Vacuum Pump Below 0.5 torr vacuum rate is recommendable.

2. Charging System An exclusive charging equipment is necessary.

LG Electronics Inc.